



### 8) Testing unit operation

The break glass unit can be tested without the need to break/replace the frangible glass element. A test key (7mm Allen key) is used to mechanically drop the glass down activating the switch.

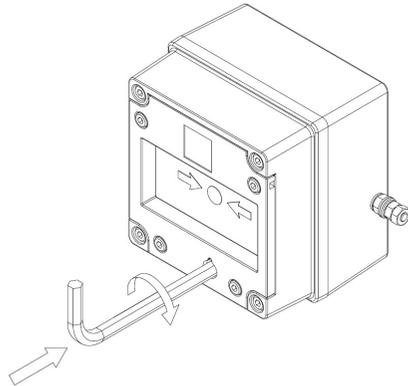

The test key is inserted in the test cam and rotated clockwise by an angle of 60° the glass element will visibly drop down in the viewable window. The call point switch will now change over its contacts to operate the alarm.

Once testing is complete the unit needs to be reset, the test key is rotated back anticlockwise by an angle of 60° back to its original position. The glass element should now raise up so it is level again in the viewable window.

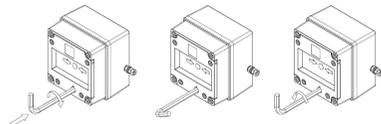


1. Insert test key rotate clockwise 60°
2. Hold in position during test
3. Rotate back anticlockwise to reset

### 9) Replacement of glass element


If the break glass unit has been operated the broken glass element can be quickly replaced.

The break glass cover plate is removed by unscrewing the 4 off M4 cap head screws attaching it.

Once cover is removed the broken glass will be free to be removed, clean out any other fragments of glass carefully.

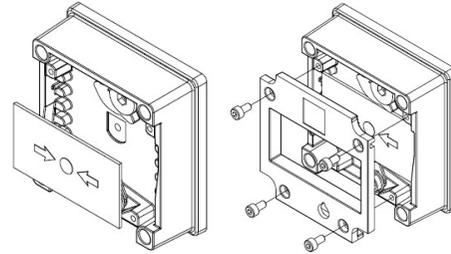

To fit the new glass element rotate the top cam clockwise by an angle of 50° (use a 6mm Allen key) this will then allow the glass to fit back into the pocket it sits in, resting on the pivot point and test cam, release the top cam to rest on the top of the glass element.

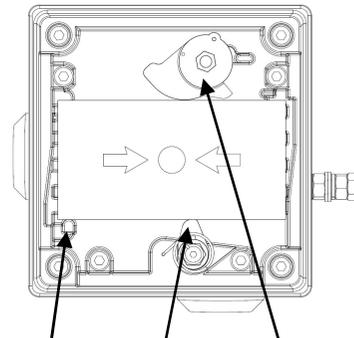

Pivot point Test Cam Top Cam (rotate)


Replace the cover plate and tighten the 4 off M4 cap head screws.

Ensure the glass element is free to move under the cover plate. This can be done by running through the units test operation. See section 8 of this instruction manual.

## IS-CP4A-BG

### Manual Call Point – Break Glass

**For use in Flammable Gas and Combustible Dust Atmospheres.**

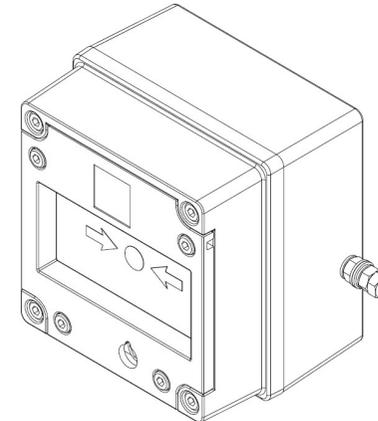

### 1) Introduction

The IS-CP4A-BG is a break glass manual call point which is certified intrinsically safe to the European and International Gas and Dust standards. The unit meets the requirements of the ATEX directive 2014/34/EU and IECEx scheme.

The call point can be used in hazardous areas where potentially flammable gas and dust atmospheres may be present.

The IS-CP4A-BG has no monitoring resistors. The units are Group II, EPL (equipment protection level) Ga. The equipment is certified 'Ex ia IIC T6 Ga' and as such may be used in Zones 0, 1 and 2 with flammable gases and vapours with gas groups IIA, IIB & IIC and temperature classes T1, T2, T3, T4, T5 and T6.

These units are also Group III, EPL Db. The equipment is certified 'Ex t IIIC T60°C Db' and as such may be used in Zones 21 and 22 for combustible dusts groups IIIA, IIIB & IIIC.

The equipment needs to be installed with ATEX and/or IECEx certified Zener Barriers or Galvanic Isolators

### 2) Marking

All units have a rating label, which carries the following important information:-

Unit Type No.:  
IS-CP4A-BG Manual Call Point

Code:  
Ex ia IIC T6 Ga  
Ex tb IIIC T60°C Db  
IP66  
-40°C ≤ Ta ≤ +55°C

Input Voltage: Dust Protection Ex tb  
AC voltage 250V Max Current 5.0A Max  
DC voltage 56V Max Current 1.0A Max

Input Voltage: Gas Protection Ex ia  
Ui=30V Ii=500mA Pi=1.1W Ci=0 Li=0

Certificate No.:  
SIRA 09ATEX2287X  
IECEX SIR 09.0122X  
CSAE 21UKEK2555X

Epsilon x:  II 1G2D

CE Marking  
Notified Body No.  2813

UKCA Marking  
Notified Body No.  0518

Year/Serial No. i.e. 10/1CP4ABG000001

**WARNING - DO NOT OPEN WHEN AN EXPLOSIVE ATMOSPHERE MAY BE PRESENT**

### 3) Type Approval Standards

The beacon has an EC Type examination certificate issued by SIRA and have been approved to the following standards:-

EN IEC 60079-0:2018 / IEC 60079-0:2017  
EN 60079-11:2012 / IEC 60079-11:2011  
IEC 60079-26:2014

EN 60079-31:2014 / IEC 60079-31:2013

The equipment is certified for use in ambient temperatures in the range -40°C to +55°C and shall not be used outside this range.

#### 4) Installation Requirements

Installation of this equipment shall only be carried out by suitably trained personnel in accordance with the applicable code of practice e.g. IEC 60079-19/EN 60079-19.

IEC 60079-14/EN 60079-14.

Repair of this equipment shall only be carried out by the manufacturer or in accordance with the applicable code of practice e.g. IEC 60079-19/EN 60079-19.

The certification of this equipment relies on the following materials used in its construction:

Enclosure: Aluminium Pressure Die Cast Body LM6

Through enclosure mechanism: Plastic Nylon Zytel Injection Moulded

Sealing of enclosure and mechanism: O-ring Acrylonitrile-Butadiene Rubber

If the equipment is likely to come into contact with aggressive substances, then it is the responsibility of the user to take suitable precautions that prevent it from being adversely affected, thus ensuring that the type of protection is not compromised.

"Aggressive substances" - e.g. acidic liquids or gases that may attack metals, or solvents that may affect polymeric materials.


"Suitable precautions" - e.g. regular checks as part of routine inspections or establishing from the material's data sheet that it is resistant to specific chemicals.

Refer to certificates SIRA 09ATEX2287X, IECEx SIR 09.0122X and CSAE 21UKEX2555X for special conditions of safe use.

#### 5) Call Point Location and Mounting


The location of the call point should enable ease of access for operation and testing. The unit should be mounted using the 4 off fixing holes which will accept up to M4 sized fixings.

When installing in Zone 0 applications, ensure that the equipment enclosure is protected from impact.

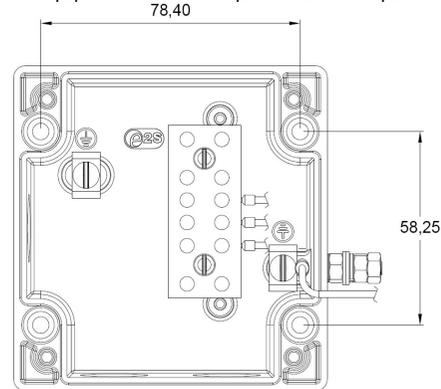

View of base unit showing fixing centres.

To gain access to the mounting holes in the base the front cover must be removed. This is achieved by removing the 4 off M4 cap head bolts holding on the cover.

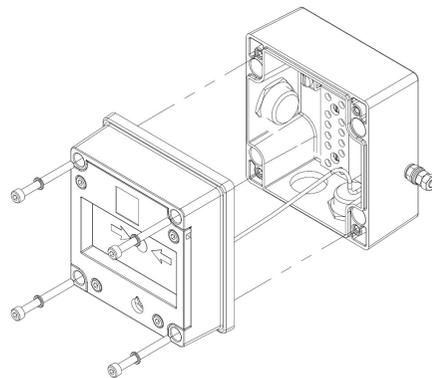

Once the screws are removed the cover will hang down out of the way to gain access to the terminal block, the internal earth terminal and mounting hole recesses.


#### 6) Earthing

The unit has both internal and external earth terminals.

It is recommended that a cable crimp lug is used on the earth wires.

The internal earth wire is placed under a earth clamp which will stop the cable twisting. This is secured by an M4 screw and spring washer.

The external earth lug should be located between the two M5 washers provided and securely locked down with the M5 spring washer and two locknuts.

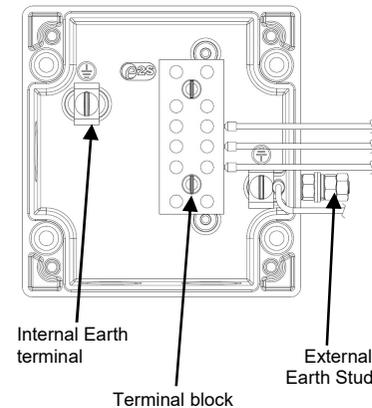

#### 7) Cable connections

There are 3 off cable entries for M20x1.5 Ex t approved cable glands or stopping plugs.

Cable glands or stopping plugs must be rated IP66.


The unit can be wired in a number of different ways depending whether normally open or normally closed contacts are required.

The equipment needs to be installed with ATEX and/or IECEx certified Zener Barriers or Galvanic Isolators

For wiring schematic refer to drawing D150-06-001

When wiring to Increased Safety terminal enclosures, you are only permitted to connect one wire into each way on the terminal block, unless a pair of wires are crimped into a suitable ferrule.


| E2S PART NO. | DESCRIPTION                              | DATA REFERENCE | ISSUE | MOD No. | REASON - INITIAL - DATE            |
|--------------|--|----------------|-------|---------|------------------------------------|
| BExCP3A-BG   | BExCP3A-BG BREAK GLASS MANUAL CALL POINT | 1.24.070       | 1     |         | INTRODUCTION<br>D.A.H - 07-02-2020 |
| BExCP3A-PB   | BExCP3A-PB PUSH BUTTON MANUAL CALL POINT | 1.24.080       |       |         |                                    |
| BExCP3A-PT   | BExCP3A-PT TOOL RESET MANUAL CALL POINT  | 1.24.090       |       |         |                                    |
| IS-CP4A-BG   | IS-CP4A-BG BREAK GLASS MANUAL CALL POINT | 1.14.010       |       |         |                                    |
| IS-CP4A-PB   | IS-CP4A-PB PUSH BUTTON MANUAL CALL POINT | 1.14.020       |       |         |                                    |
| IS-CP4A-PT   | IS-CP4A-PT TOOL RESET MANUAL CALL POINT  | 1.14.030       |       |         |                                    |

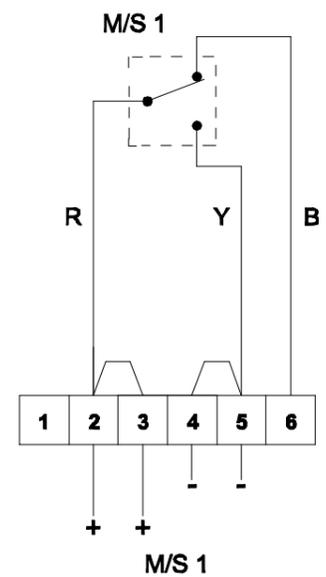

**Unit in 'Standby condition' unoperated**

Terminal +(2,3) & (6) switch contacts closed

Terminals +(2,3) & -(4,5) switch contacts open

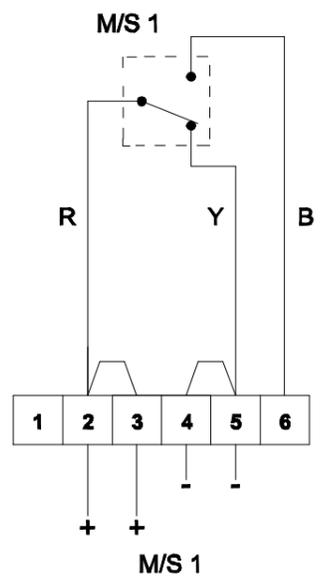

**Unit in 'Operated condition' (broken glass / Button pushed in)**

microswitch contacts changed over

Terminal +(2,3) & (6) switch contacts open

Terminals +(2,3) & -(4,5) switch contacts closed

DRAWING TO BS8888:2000  
GEOMETRIC TOLERANCES TO ISO1101:1983  
LINEAR DIMENSIONAL TOLS  
ANGULAR DIMENSIONAL TOLS

STANDARDS  
**BExCP6A CALL POINTS**

|          |           |      |          |
|----------|-----------|------|----------|
| DRAWN    | D.HOWGILL | DATE | 07-02-20 |
| CHECKED  | R.N.POTTS | DATE | 07-02-20 |
| APPROVED | R.N.POTTS | DATE | 07-02-20 |

|                      |             |
|----------------------|-------------|
| SURFACE FINISH       | WEIGHT (Kg) |
| MATERIAL             |             |
| ALTERNATIVE MATERIAL |             |

THIS DRAWING AND ANY INFORMATION OR DESCRIPTIVE MATTER THEREIN IS COMMUNICATED IN CONFIDENCE AND IS THE COPYRIGHT PROPERTY OF EUROPEAN SAFETY SYSTEMS LTD. NEITHER THE WHOLE OR ANY EXTRACT MAY BE DISCLOSED, LOANED, COPIED OR USED FOR MANUFACTURING OR TENDERING PURPOSES WITHOUT THEIR WRITTEN CONSENT.

© EUROPEAN SAFETY SYSTEMS LTD.  
AS PER LATEST DATE OF ISSUE SHOWN ABOVE

**2S**  
warning signals

EUROPEAN SAFETY SYSTEMS LTD  
IMPRESS HOUSE  
MANSELL ROAD  
ACTON  
LONDON W3 7QH  
WWW.E2S.COM

|  |        |                    |           |
|--|--------|--------------------|-----------|
| ALL DIMENSIONS IN MM<br>IF IN DOUBT, ASK -<br>DO NOT SCALE       |        |                    | <b>A3</b> |
| <b>TITLE BExCP3A-BG/PB/PT MANUAL CALL POINT WIRING SCHEMATIC</b> |        |                    |           |
| SCALE  | SHEET  | DRAWING NUMBER     |           |
| NTS  | 1 OF 1 | <b>D150-06-001</b> |           |

# EU Declaration of Conformity



Manufacturer: European Safety Systems Ltd.  
Impress House, Mansell Road, Acton  
London, W3 7QH  
United Kingdom

Authorised Representative: E2S Warnsignaltechnik UG  
Charlottenstrasse 45-51  
72764 Reutlingen  
Germany

Equipment Type: IS-CP4A, IS-CP4B, BExCP5B

---

## Directive 2014/34/EU: Equipment and Protective Systems for use in Potentially Explosive Atmospheres (ATEX)

|   |   |
|---|---|
| Notified Body for EU type Examination (Module B):   | Sira Certification Service<br>Notified Body No.: 2813<br>CSA Group Netherlands B.V, Utrechtseweg 310, 6812 AR, Arnhem, Netherlands  |
| EU-type Examination Certificate (Module B):   | SIRA 09ATEX2287X  |
| Notified Body for Quality Assurance Notification / Conformity to EU-type based on quality assurance of the production process (Module D): | Sira Certification Service<br>Notified Body No.: 2813<br>CSA Group Netherlands B.V, Utrechtseweg 310, 6812 AR, Arnhem, Netherlands  |
| Quality Assurance Notification (Module D):  | SIRA 05 ATEX M342   |
| Provisions fulfilled by the equipment:  | IS-CP4A:<br>II 1G Ex ia IIC T6 Ga (-40°C ≤ Ta ≤ +55°C)<br>II 2D Ex tb IIIC T60°C Db (-40°C ≤ Ta ≤ +55°C)<br>IP6X Dust Protection to EN60079-0 / EN60079-31<br>IS-CP4B:<br>II 1G Ex ia IIC T4 Ga (-40°C ≤ Ta ≤ +55°C)<br>BEx-CP5B:<br>II 2D Ex tb IIIC T70°C Db (-40°C ≤ Ta ≤ +50°C)<br>IP6X Dust Protection to EN60079-0 / EN60079-31 |
| Standards applied:  | EN IEC 60079-0:2018<br>EN 60079-11:2012<br>IEC 60079-26:2014<br>EN 60079-31:2014  |

## Directive 2014/30/EU: Electromagnetic Compatibility Directive (EMC)

|                    |  |
|--------------------|--|
| Standards applied: | EN 61000-6-1:2007<br>EN 61000-6-2:2005<br>EN 61000-6-3:2007 / A1:2011 / AC: 2012<br>EN 61000-6-4:2007 / A1: 2011 |
|--------------------|--|

## Directive 2011/65/EU: Restriction of the use of certain hazardous substances in electrical and electronic equipment (RoHS)

The product and all the components contained within it are in accordance with the restriction of the use of hazardous substances in electrical and electronic equipment, including amendment by Directive 2015/863/EU.

## Regulation (EC) 1907/2006: Registration, Evaluation, Authorisation and Restriction of Chemicals (REACH)

The product and all the components contained within it are free from substances of very high concern.

## Other Standards and Regulations

EN 60529:1992+A2:2013 - Degrees of protection provided by enclosures (IP code) – enclosure rated IP66  
Construction and design requirements according to EN54-11:2001 clause 4.7 – IS-CP4A-BG / B-BG only (fitted with burning house symbol shown in figure 3a and no lift flap)

# EU Declaration of Conformity



---

On behalf of European Safety Systems Ltd., I declare that, on the date the equipment accompanied by this declaration is placed on the market, the equipment conforms with all technical and regulatory requirements of the above listed directives, regulations and standards.  
This Declaration is issued under the sole responsibility of the manufacturer.

A handwritten signature in black ink, appearing to read 'Martin Streetz'.

Martin Streetz  
Quality Assurance Manager

Document No.: DC-008\_Issue\_J  
Date and Place of Issue: London, 23/12/2020



# UKCA Declaration of Conformity



Manufacturer: European Safety Systems Ltd.  
Impress House, Mansell Road, Acton  
London, W3 7QH  
United Kingdom

Equipment Type: IS-CP4A, IS-CP4B, BExCP5B

---

Directive UKSI 2016:1107 (as amended by UKSI 2019:696) – Schedule 3A, Part 1 : Product or Protective System Intended for use in Potentially Explosive Atmospheres (UKCA)

|   |   |
|---|---|
| Notified Body for UK type Examination (Module B):   | Sira Certification Service<br>Notified Body No.: 0518<br>Rake Lane, Eccleston, Chester CH4 9JN, UK  |
| UK-type Examination Certificate (Module B):   | CSAE 21UKEX2555X  |
| Notified Body for Quality Assurance Notification / Conformity to EU-type based on quality assurance of the production process (Module D): | Sira Certification Service<br>Notified Body No.: 0518<br>Rake Lane, Eccleston, Chester CH4 9JN, UK  |
| Quality Assurance Notification (Module D):  | CSAE 22UKQAN0046  |
| Provisions fulfilled by the equipment:  | IS-CP4A:<br>II 1G Ex ia IIC T6 Ga (-40°C ≤ Ta ≤ +55°C)<br>II 2D Ex tb IIIC T60°C Db (-40°C ≤ Ta ≤ +55°C)<br>IP6X Dust Protection to EN60079-0 / EN60079-31<br>IS-CP4B:<br>II 1G Ex ia IIC T4 Ga (-40°C ≤ Ta ≤ +55°C)<br>BEx-CP5B:<br>II 2D Ex tb IIIC T70°C Db (-40°C ≤ Ta ≤ +50°C)<br>IP6X Dust Protection to EN60079-0 / EN60079-31 |
| Standards applied:  | EN IEC 60079-0:2018<br>EN 60079-11:2012<br>IEC 60079-26:2014<br>EN 60079-31:2014  |

Directive 2014/30/EU: Electromagnetic Compatibility Directive (EMC)

|                    |  |
|--------------------|--|
| Standards applied: | EN 61000-6-1:2007<br>EN 61000-6-2:2005<br>EN 61000-6-3:2007 / A1:2011 / AC: 2012<br>EN 61000-6-4:2007 / A1: 2011 |
|--------------------|--|

Directive 2011/65/EU: Restriction of the use of certain hazardous substances in electrical and electronic equipment (RoHS)

The product and all the components contained within it are in accordance with the restriction of the use of hazardous substances in electrical and electronic equipment, including amendment by Directive 2015/863/EU.

Regulation (EC) 1907/2006: Registration, Evaluation, Authorisation and Restriction of Chemicals (REACH)

The product and all the components contained within it are free from substances of very high concern.

Other Standards and Regulations

EN 60529:1992+A2:2013 - Degrees of protection provided by enclosures (IP code) – enclosure rated IP66  
Construction and design requirements according to EN54-11:2001 clause 4.7 – IS-CP4A-BG / B-BG only (fitted with burning house symbol shown in figure 3a and no lift flap)



# UKCA Declaration of Conformity



---

On behalf of European Safety Systems Ltd., I declare that, on the date the equipment accompanied by this declaration is placed on the market, the equipment conforms with all technical and regulatory requirements of the above listed directives, regulations and standards.  
This Declaration is issued under the sole responsibility of the manufacturer.

Martin Streetz  
Quality Assurance Manager

Document No.: DC-091\_Issue\_A  
Date and Place of Issue: London, 04/02/2022